STATE: Uttar Pradesh

DATED: 08/06/2011

Note: - As per NCVT decision all the instructors must be trained within three years. The State Director/Commissioner/Pvt management are requested to sponsor 30% instructors every year for Training in Trainer Program (in any CTI module) of DGET field Institute.

SCIR (Standing Committee Inspection Report); DIR (Departmental Inspection Report); Std. Comm Standing Committee); NR (Not Recommended); NC (Not Considered); STR (Supplementary Inspection Report); PS (Power Supply); T&E (Tools & Equipment)
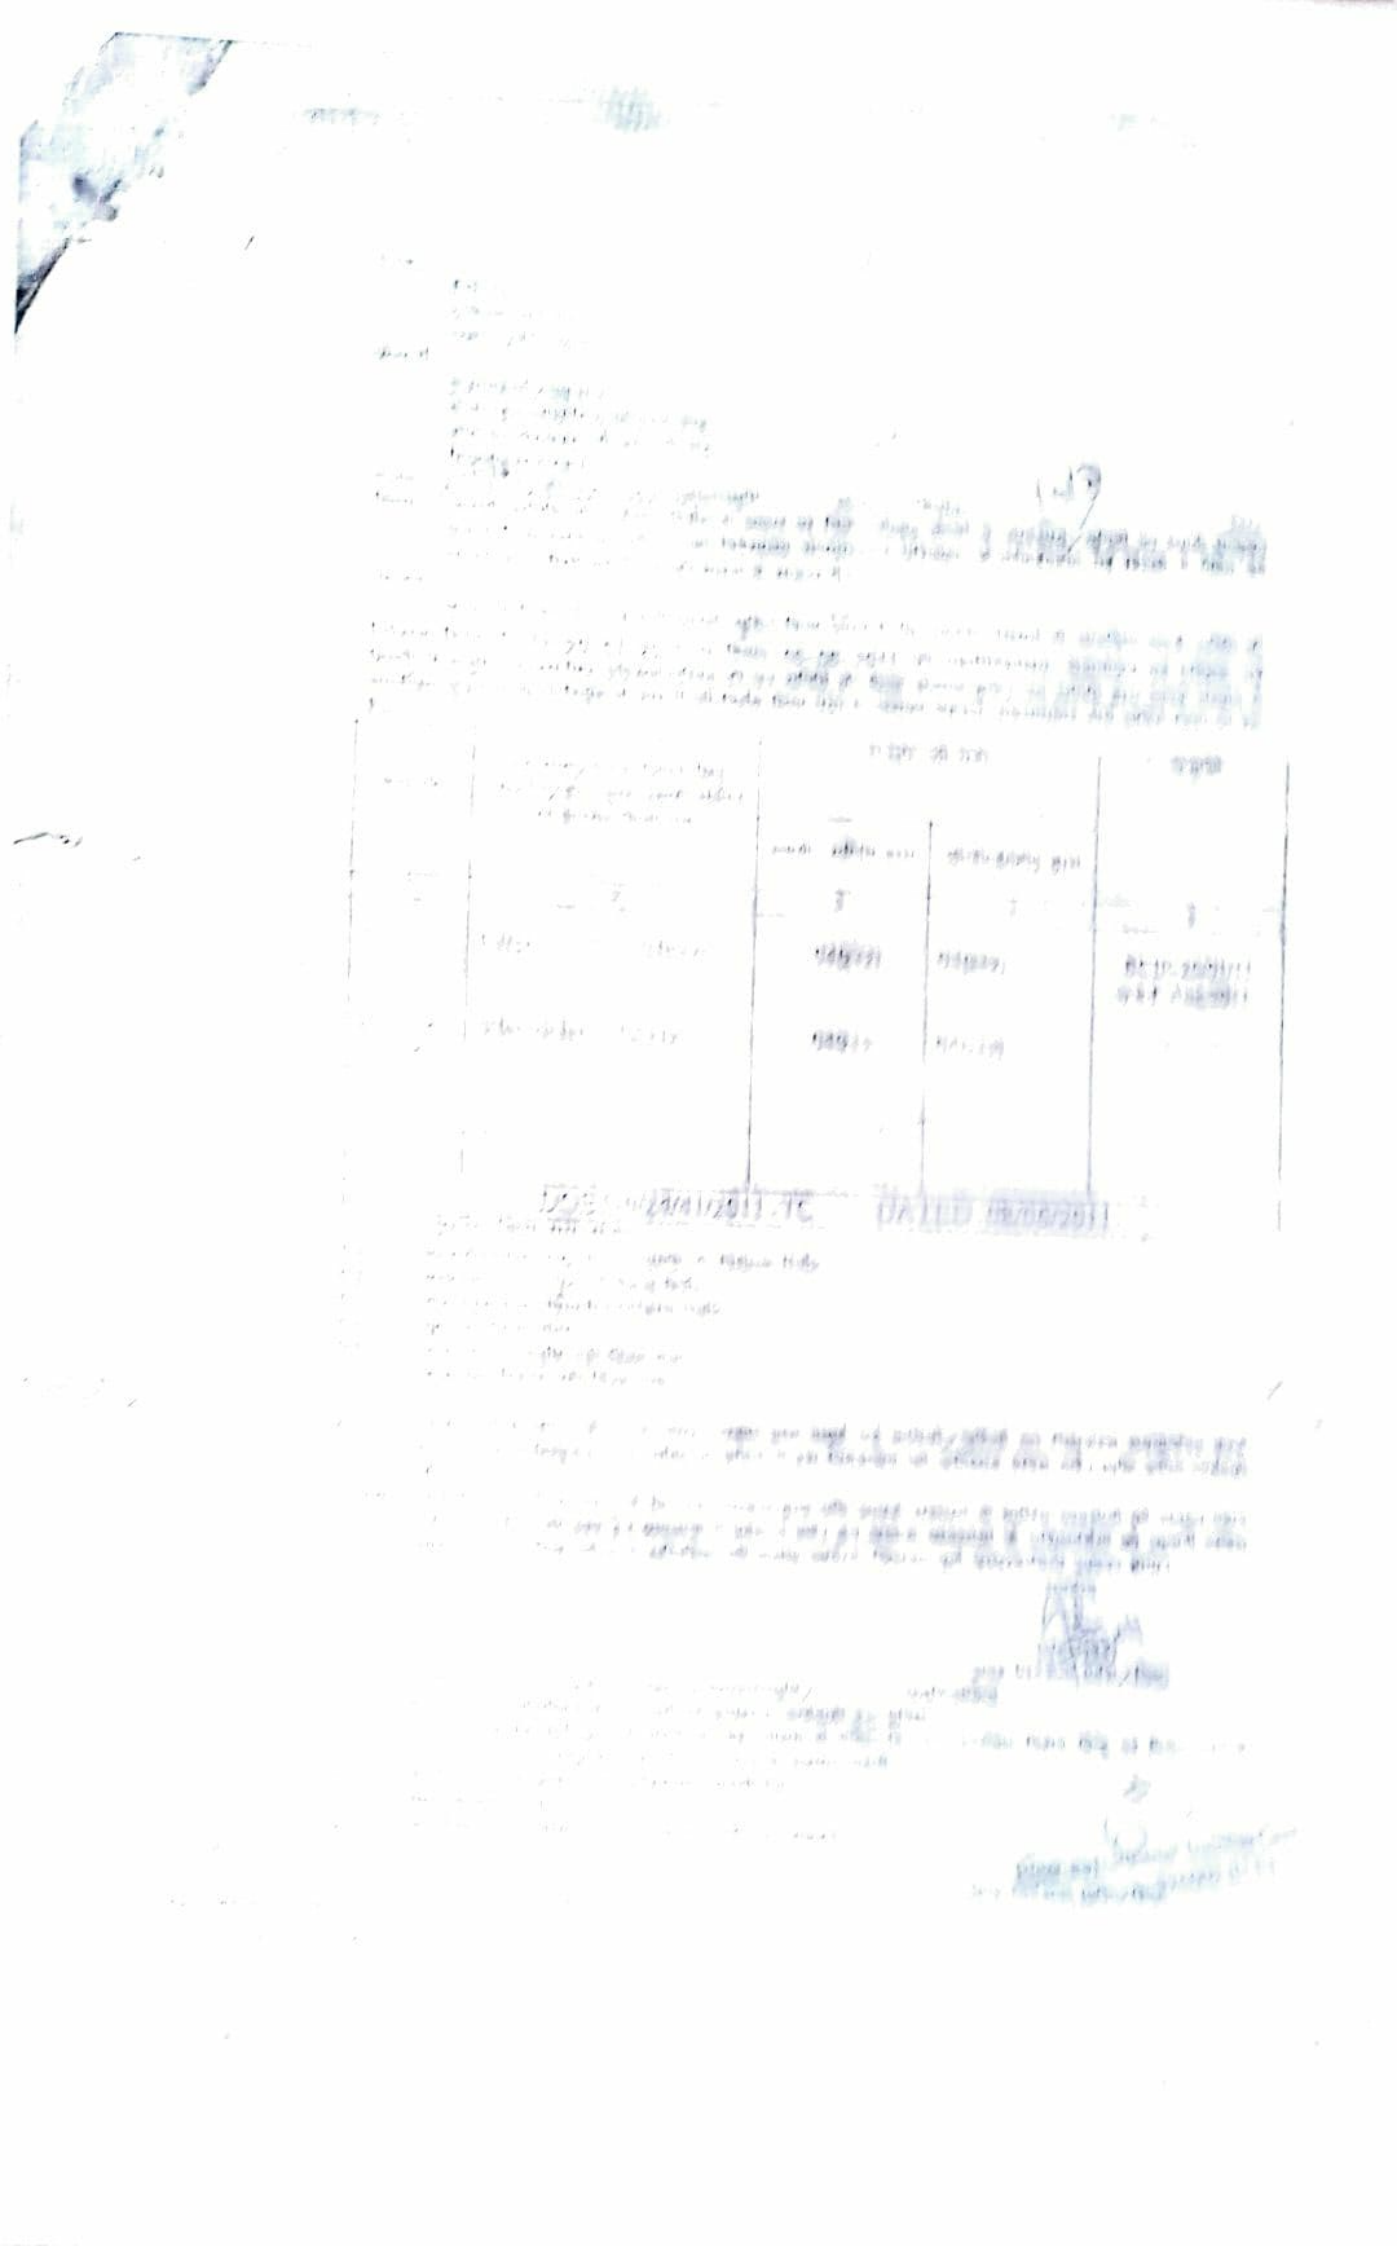
Name Address & File No. of Institute for ref. & Future correspondence draft	Trade	Units for which affiliation sought / recommended by			Approval by Sub-Committee of NCVT	Remarks
		Instt.	Std. Comm.	DGET		
[illegible] Ram Ramkali Devi ITC E-7 Bhagwan [illegible] P.O. Aduki NH-2, [illegible] Mathura [illegible] Pradesh DGET-6/24/83/2010-TC	Electrician	Addl. Two units	-	Addl. Two units Total 6(2+2+2)	Addl. Two units Total 6(2+2+2)	DIR-7/4/2011 w.e.f. Aug 2011
[illegible] ITC Vill & Post [illegible] Kursi Road, Distt. Lucknow-[illegible] Uttar Pradesh	Electrician	Addl. One Unit	-	Addl. One Unit Total 3(1+1+1)	Addl. One Unit Total 3(1+1+1)	DIR-26/3/2011 w.e.f. Aug 2011
	Fitter	Addl. One Unit	-	Addl. One Unit Total 3(1+1+1)	Addl. One Unit Total 3(1+1+1)	
DGET-6/24/[illegible]/2010-TC [illegible] [illegible] Mau Road, Post [illegible] Distt. [illegible] Uttar Pradesh	Fitter	4(2+2)	4(2+2)	4(2+2)	4(2+2)	SCIR-20/1/2011 w.e.f. Aug 2011
	Electrician	4(2+2)	4(2+2)	4(2+2)	4(2+2)	
DGET-6/24/41/2011-TC [illegible] [illegible] ITC, Kasaunder, [illegible] Ballia [illegible] Pradesh DGET-6/24/[illegible]/2009-TC	Welder	2(1+1)	2(1+1)	2(1+1)	2(1+1)	SCIR-19/12/2010 w.e.f. Aug 2011 *1. Bill for MS Office shows only 3 user license. 2. Operating system bills not attached. 3. Bill for software (Inventory, financial statement viz. tally etc not attached 4. Certificate of Sh Brijesh Kumar to be submitted once again. S/D to clarify.
	COPA	2(1+1)	2(1+1)